


MAR 20 1966

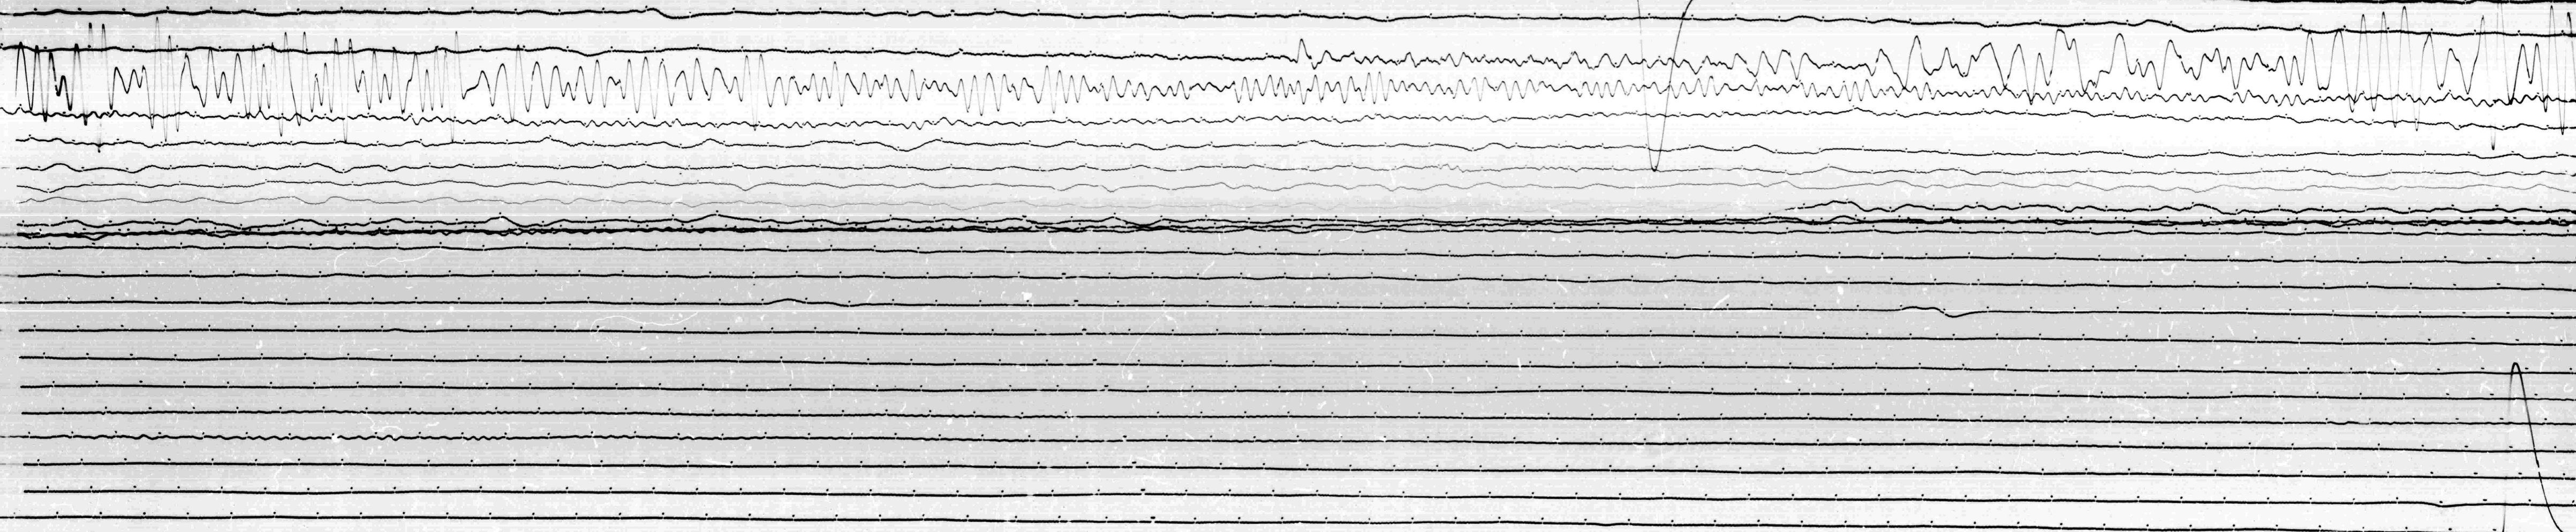

MAR 20 1966

SED NS 2fo a/c 0.10
 3-20-66 000 50 000
 3-20-66 220t -300 0 220t
 1/ 100 power out N